



WESTERN ELECTRO - ACOUSTIC LABORATORY

A division of Veneklasen Associates, Inc.

T E S T I N G • C A L I B R A T I O N • R E S E A R C H

25132 Rye Canyon Loop Santa Clarita, California 91355 Tel: (661) 775-3741 Fax: (661) 775-3742 www.weal.com

SOUND ABSORPTION TEST REPORT NO. AB11-211

Pacific Albus EcoGrille (6 member) on 1.5" fiberglass duct liner
("A" mounting)

CLIENT: **9Wood**
999 South A Street
Springfield, OR 97477

Page 1 of 3
27 October 2011

TEST DATE: 26 October 2011

INTRODUCTION

The methods and procedures used for this test conform to the provisions and requirements of ASTM Procedure C 423-09a, *Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method*. Copies of the test standard are available at www.astm.org. The test chamber volume is 275 cubic meters. Western Electro-Acoustic Laboratory is accredited by the United States Department of Commerce, National Institute of Standards and Technology under the National Voluntary Accreditation Program (NVLAP) Lab Code 100256-0 for this test procedure. This test report relates only to the item(s) tested. This report must not be used to claim product certification, approval, or endorsement by WEAL, NVLAP, NIST or any agency of the federal government.

DESCRIPTION OF TEST SPECIMEN


The test specimen was a 9Wood 6 member Pacific Albus EcoGrille assembly. The specimen consisted of nine grilles, each of which was approximately 2.44 m (96 inches) by 305 mm (12 inches) by 41.3 mm (1-5/8 inches) thick. Each grille consisted of six 28.6 mm (1-1/8 inch) by 15.9 mm (5/8 inch) slats on edge with 34.9 mm (1-3/8 inch) spaces between them. The slats and spaces were maintained with 12.7 mm (1/2 inch) by 31.8 mm (1-1/4 inch) backer strips stapled to the back of the slats. The grilles were backed with nominal 38.1 mm (1-1/2 inch) thick 24.0 kg/m³ (1.5 lbs./ft³) density fiberglass duct liner. The specimen was placed directly on the test chamber floor. The duct liner was placed on the floor with the scrim side down. The grilles sat on the duct liner and the edges of the specimen were covered with angle aluminum around the entire perimeter of the test specimen. The angle aluminum was taped to the chamber floor around the entire perimeter. According to the manufacturer the specimen was:

Pacific Albus EcoGrille (6 member) on 1.5" fiberglass duct liner

The net dimensions of the assembly were 2.74 m (108 inches) by 2.44 m (96 inches) by 79.4 mm (3-1/8 inches) thick. The overall weight of the specimen was 34.0 kg (75 lbs.).

Test results are presented on the following page as well as the ASTM estimate of reproducibility, R, and repeatability, r, of the sound absorption coefficients of a specimen in a Type A mounting.

Respectfully submitted,
Western Electro-Acoustic Laboratory

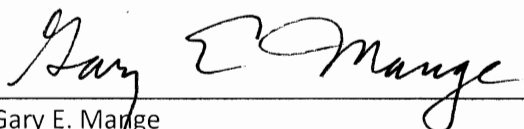
Gary E. Marge
Laboratory Manager

SOUND ABSORPTION TEST REPORT NO. AB11-211

TEST DATE: 26 October 2011

Page 2 of 3
27 October 2011

Mounting per ASTM E 795-00: Type A

Area tested: 72.0 ft² (6.69 m²)

Temperature: 76.8° F

Humidity: 43.5%

Pressure: 28.61 in. of Hg

TEST RESULTS

1/3 Octave Band Absorption Data


Frequency in Hz	Absorption in Sabins	Absorption Coefficients	Reproducibility R	Repeatability r
100	9.4	0.13	0.27	0.15
125	4.3	0.06	0.22	0.11
160	15.3	0.21	0.23	0.11
200	30.5	0.42	0.17	0.09
250	41.4	0.57	0.15	0.07
315	54.7	0.76	0.22	0.09
400	56.1	0.78	0.16	0.14
500	58.0	0.81	0.14	0.09
630	69.1	0.96	0.14	0.06
800	66.2	0.92	0.14	0.07
1000	65.0	0.90	0.12	0.06
1250	62.3	0.87	0.13	0.05
1600	58.1	0.81	0.14	0.05
2000	54.9	0.76	0.13	0.05
2500	57.8	0.80	0.14	0.06
3150	57.6	0.80	0.15	0.08
4000	51.1	0.71	0.16	0.11
5000	47.4	0.66	0.21	0.15

NRC 0.75
SAA 0.78

SOUND ABSORPTION TEST REPORT No. AB11-211

TEST DATE: 26 October 2011

Page 3 of 3
27 October 2011

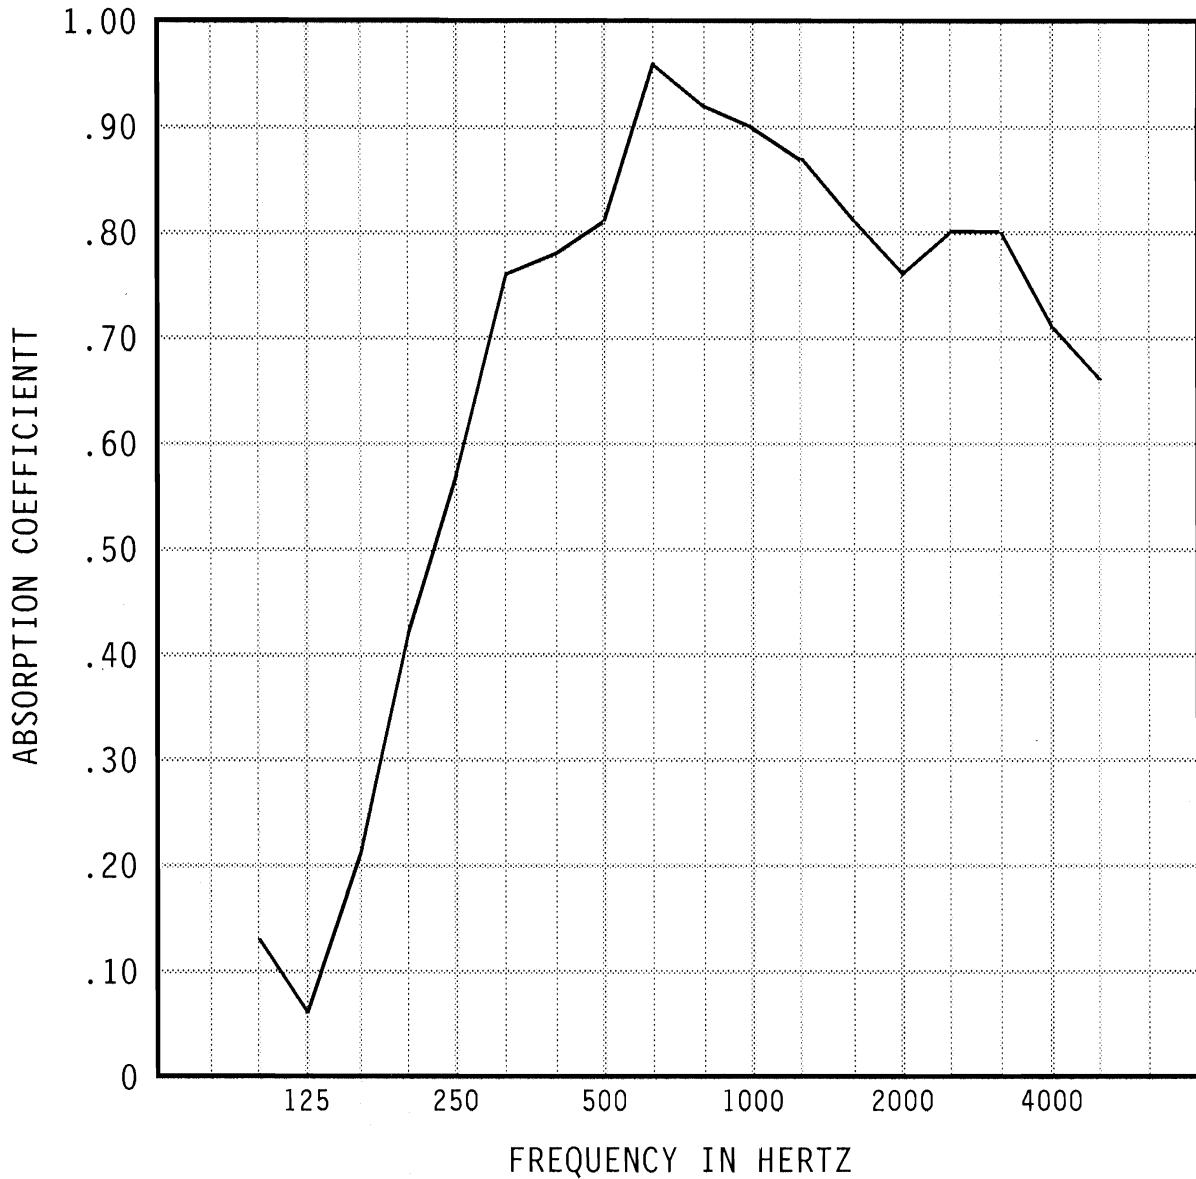

Specimen Area: 72 sq.ft.
Temperature: 76.8 deg. F
Relative Humidity: 43.5 %

Report must be distributed in its entirety except with written authorization from Western Electro-Acoustic Laboratory

NVLAP[®]

NVLAP LAB CODE 100256-0